


Fig. 11

SINGLE PHASE, 3WIRE, 120/208 VOLT
METER WIRING DIAGRAM
200 AMP

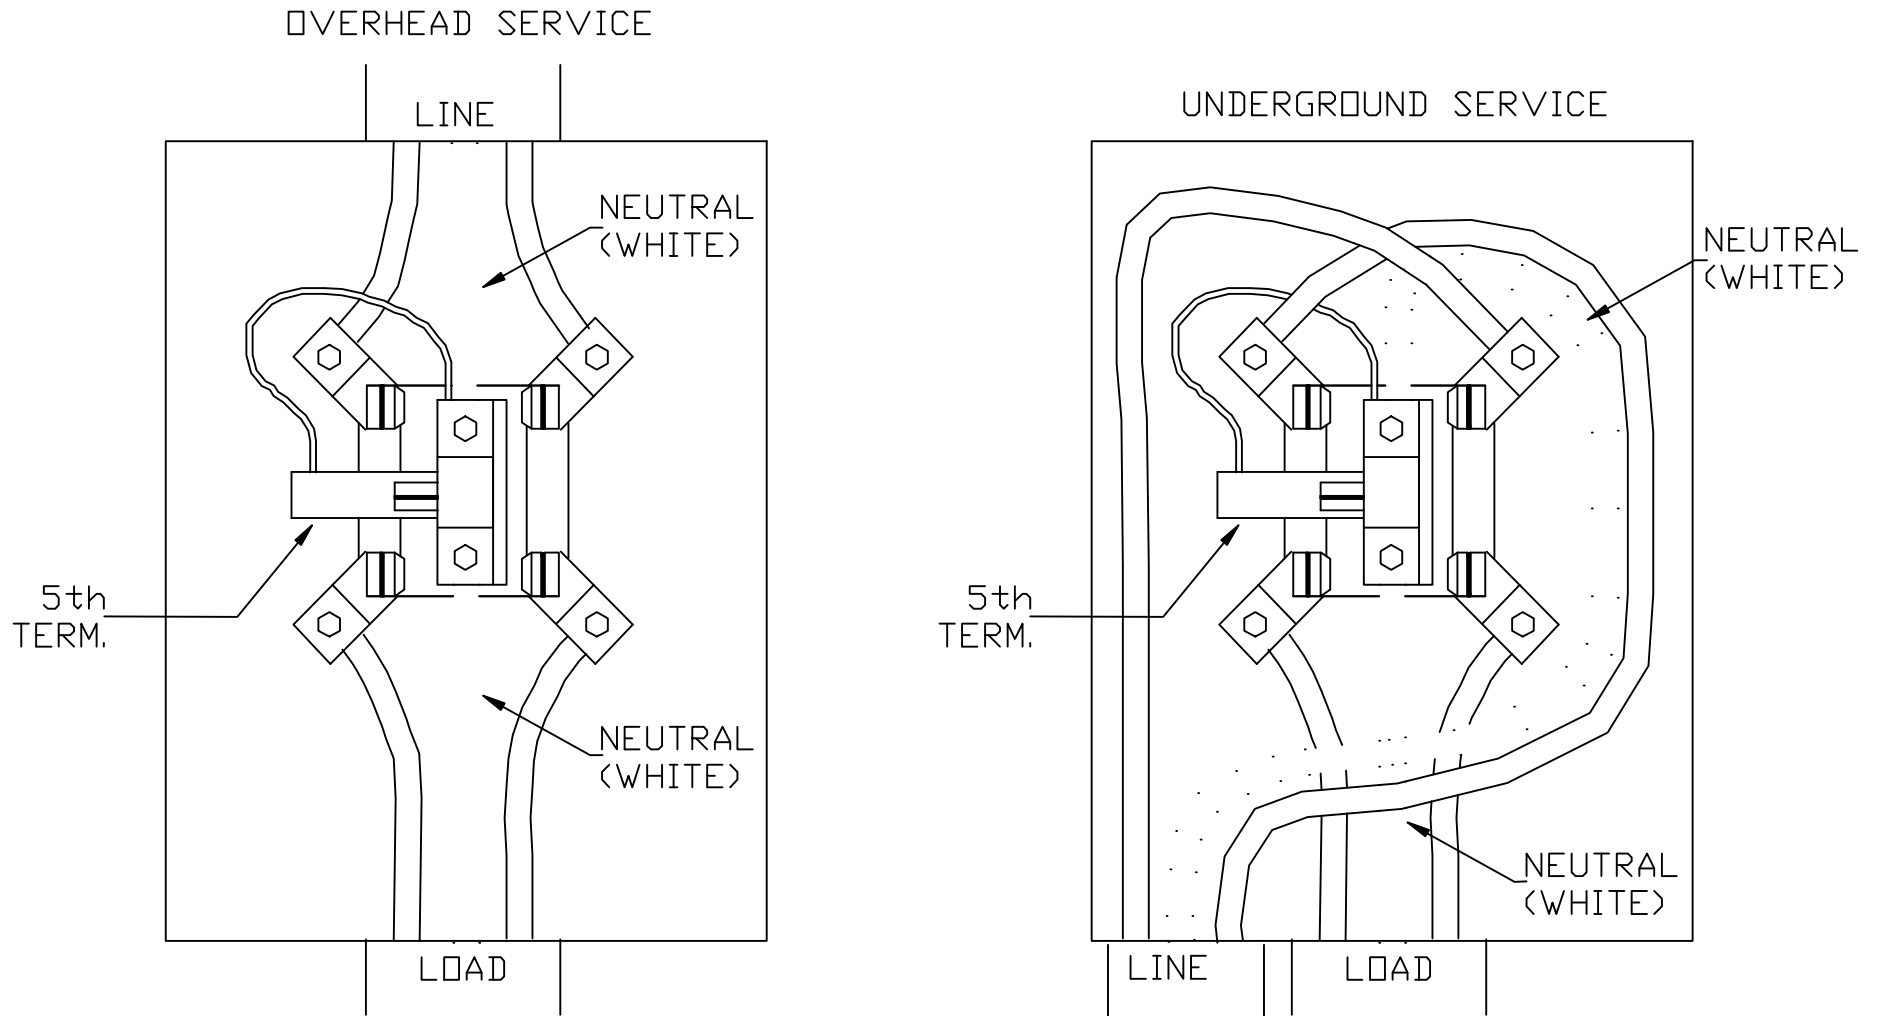

THE FIFTH TERMINAL AS SHOWN SHALL BE PROVIDED BY THE
ELECTRICAL CONTRACTOR.