


Fig. 6

**STANDARD SERVICE
MAST INSTALLATION**

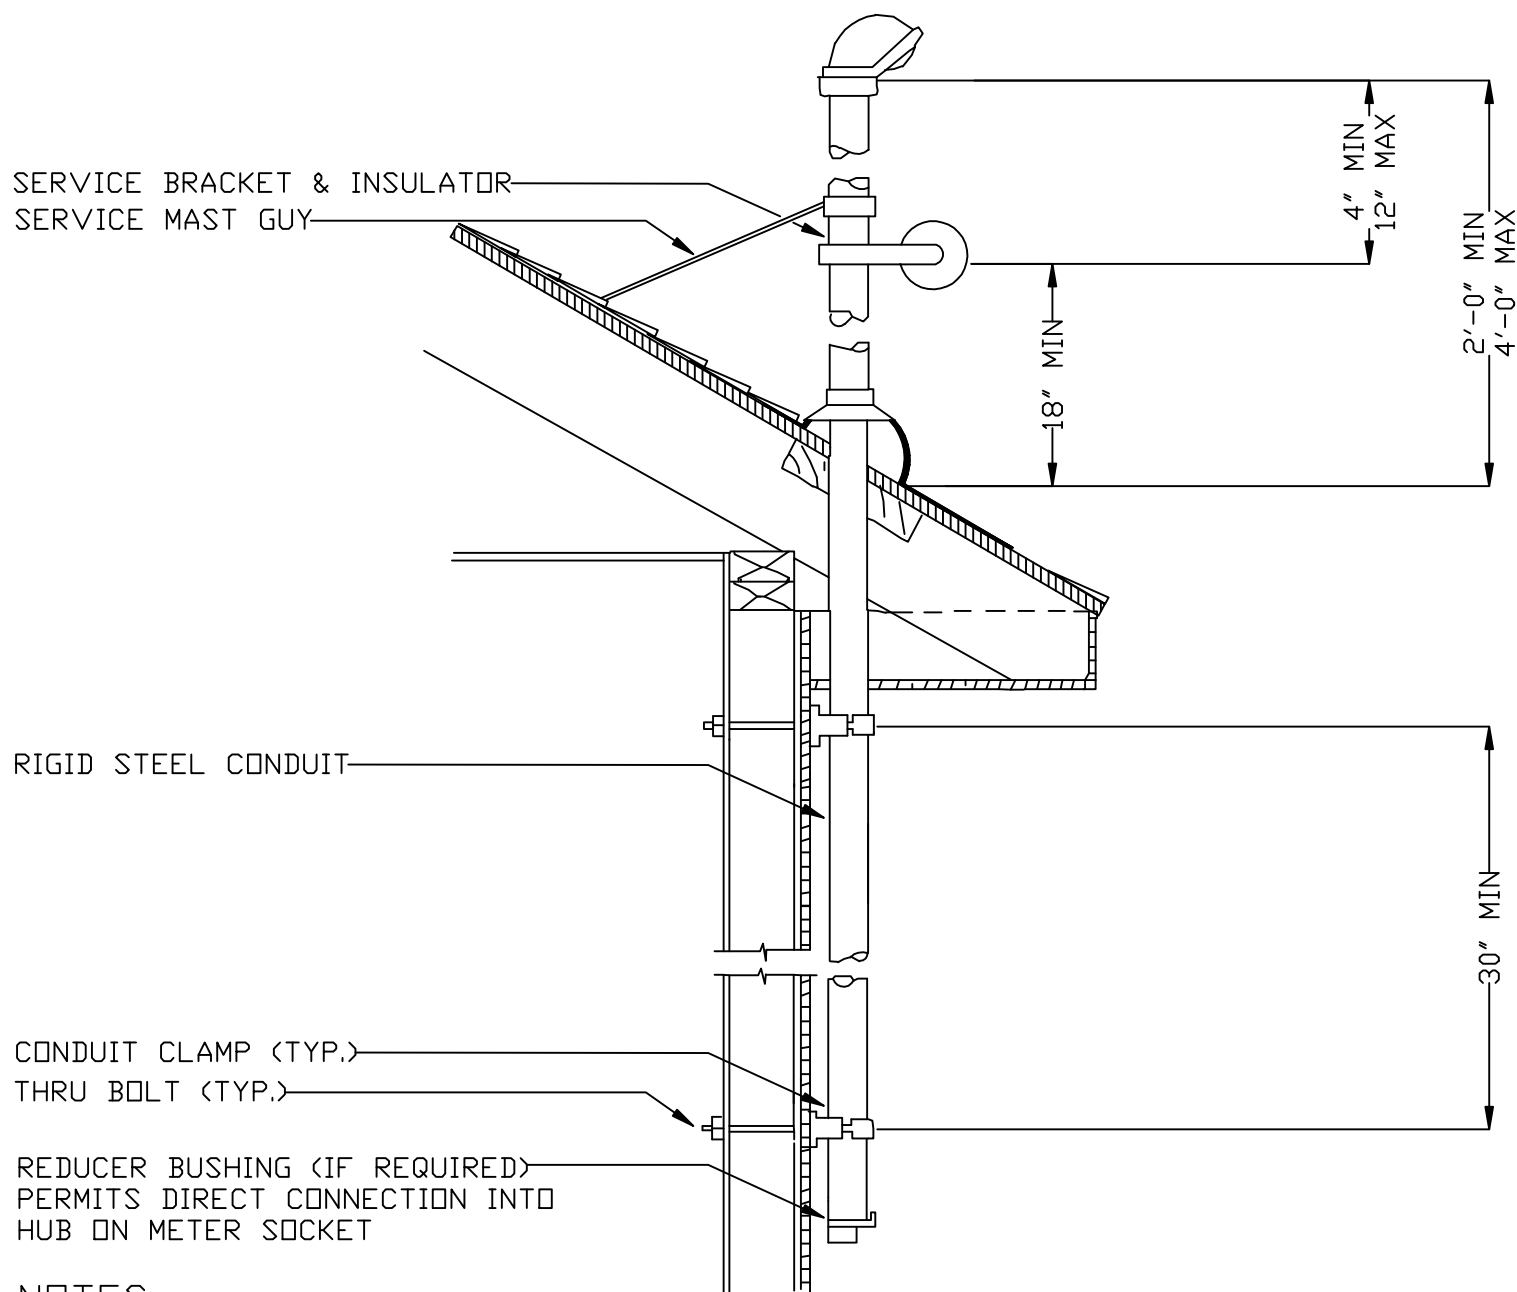

NOTES:

1. APPROVAL FOR LOCATION MUST BE OBTAINED FROM THE CITY OF NEWARK BEFORE INSTALLATION.
2. GUYING REQUIRED FOR SERVICE DROPS OVER 50'.
3. GUYING REQUIRED IF TOP OF MAST (EXCLUDING WEATHERHEAD) IS MORE THAN 26" ABOVE ROOF.
4. SERVICE BRACKET AND INSULATOR HEIGHT MUST ALLOW MINIMUM REQUIRED CLEARANCES TO GROUND AS PER N.E.C.