


Fig. 5

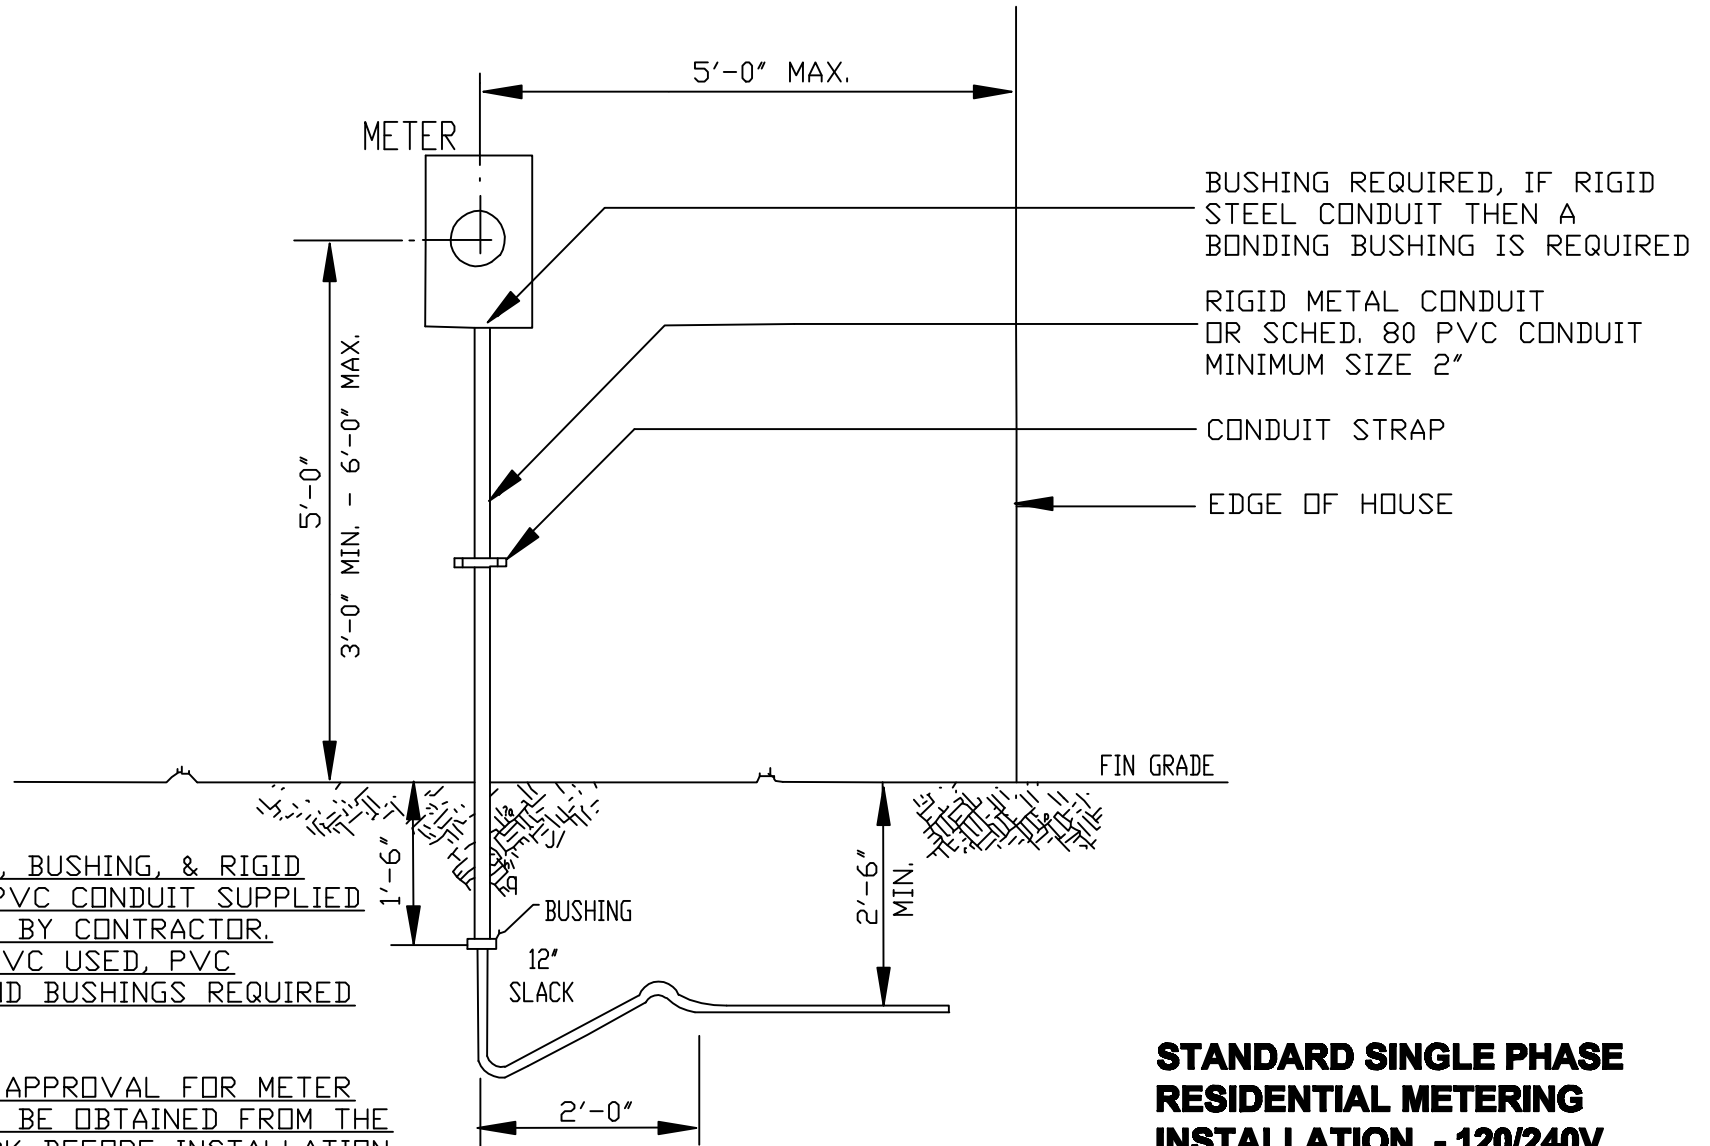

NOTES:

1. CONDUIT STRAP, BUSHING, & RIGID OR SCHED. 80 PVC CONDUIT SUPPLIED AND INSTALLED BY CONTRACTOR. IF SCHED. 80 PVC USED, PVC CONNECTORS AND BUSHINGS REQUIRED AT BOTH ENDS.
2. IN ALL CASES APPROVAL FOR METER LOCATION MUST BE OBTAINED FROM THE CITY OF NEWARK BEFORE INSTALLATION.
3. METER BOX SUPPLIED AND INSTALLED BY CONTRACTOR.

**STANDARD SINGLE PHASE
RESIDENTIAL METERING
INSTALLATION - 120/240V**